


User manual

ALFA(NET) 31 -50/+150°C

Cool/Heat Thermostat.

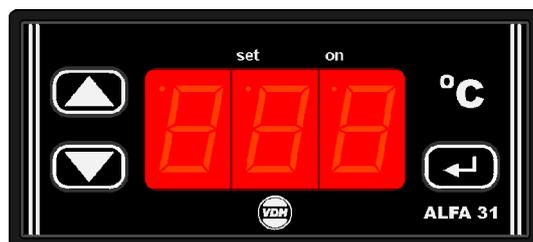

VDH doc. 091122

Version: v1.0

Date: 19-11-2009

Software: ALFA(NET)31 -50/+150°C

File: Do091122.wpd

Range: -50/+150°C per 1°C

* **Function.**

The **ALFA(NET) 31** is a digital thermostat for panel mounting. The function from the thermostat can be programmed for cooling or heating.

The **ALFANET31** has a RS 485 network connection so it can be read out and adjusted on the Alfanel.

* **Installation.**

On the topside of the **ALFA(NET) 31** you can see how the sensor, power supply and relay have to be connected.

After connecting the **ALFA(NET) 31** to the power supply, a self test function is started. As this test is finished, the measured temperature appears in the display.

When the relay is activated, the led 'on' will light-up in the display.

* **Control.**

The **ALFA(NET) 31** thermostat can be controlled by three pushbuttons on the front. These keys are;

-  **SET** - view / change the setpoint.
-  **UP** - increase the setpoint.
-  **DOWN** - decrease the setpoint.

* **Viewing setpoint.**

By pushing the **SET** key the setpoint appears in the display. The led 'set' starts blinking. A few seconds after releasing the **SET** key the setpoint disappears and the measured temperature is shown in the display.

* **Changing setpoint.**

Push the **SET** key and the setpoint appears in the display. Release the **SET** key. Now push the **SET** key again and together with the **UP** or **DOWN** keys the setpoint can be changed. A few seconds after releasing the keys the measured temperature shows again in the display.



* **Setting internal parameters.**

Next to the adjustment of the setpoint, some internal settings are possible like differential, sensor-offset, setpoint range and the function cooling or heating.

By pushing the **DOWN** key for more than 10 seconds, you enter the 'internal programming menu'. In the left display the upper and lower segment, are blinking. With the **UP** and **DOWN** keys the required parameter can be selected (see the parameter table). If the required parameter is selected, the value can be read-out by pushing the **SET** key. Pushing the **UP** or **DOWN** keys, together with the **SET** key allows you to change the value of this parameter.

If no key is pushed for 20 seconds, the **ALFA(NET) 31** changes to its normal operation mode.

* **Adjustment sensor.**

The sensor can be adjusted by using the Sensor Offset (parameter 04). Indicates the **ALFA(NET) 31** e.g. 2°C too much, the Sensor Offset has to be decreased by 2°C.

* **Error messages.**

In the display of the **ALFA(NET) 31** the following error messages can appear:

Er - Sensor broken. Solution:
- Check if the sensor is connected correctly.
- Check the sensor (1000Ω at 25°C).
- Replace the sensor.

EE - Settings are lost. Solution:
- Reprogram the settings.

* **Technical details.**

Model : ALFA(NET) 31
Range : -50/+150°C, readout per 1°C
Supply : 230Vac 50/60Hz (or else see product sticker), Max. 3VA
Relay : SPDT 250V/16A(C-NO), 8A(C-NC) (cos phi=1)
Communication: RS 485 Network (2xtwisted pair shielded) only at ALFANET model.
Control : by pushbuttons on the front.
Front : Polycarbonate IP65
Sensor : SM 811/2m (1000Ω at 25°C)
Sizes : 35 x 77 x 71,5mm (hwd)
Panel hole : 28 x 70mm (hw)

- Provided with memory protection during power failure.
- Connection with screw terminals on the back side.
- Equipped with self test function and sensor failure detection.
- Special versions are available upon request.




* **Parameters ALFA(NET) 31.**


PARAMETER	DESCRIPTION PARAMETER	RANGE	STANDARD VALUE
01	Switching differential	1..30°C	3
02	Minimum setpoint	-50..+150°C	-50
03	Maximum setpoint	-50..+150°C	+150
04	Offset temperature sensor	-15..+15°C	0
10	Startup delay after power failure	0..99 Minutes	0
11	Relays on at sensor failure	0 = No 1 = Yes	0
15	Function cooling or heating	0 = Cool 1 = Heat	0
16	Switch on delay relays	1) 0..99	0
17	Switch off delay relays	1) 0..99	0
18	Parameter 16/17 in seconds or minutes	0 = Seconds 1 = Minutes	0
19	Minimum on-time relays	0..99 Minutes	0
20	Minimum off-time relays	0..99 Minutes	0
90	Network number	1..250	1
95	Software version	0..255	-
96	Production year	00..99	-
97	Production week	1..52	-
98	Serial number (x1000)	0..255	-
99	Serial number (units)	0..999	-

1) On active delay led 'on' blinks.


* **Function Diagram.**

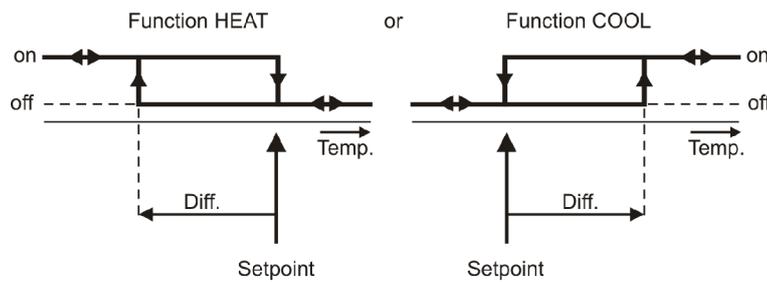

* **Dimensions.**

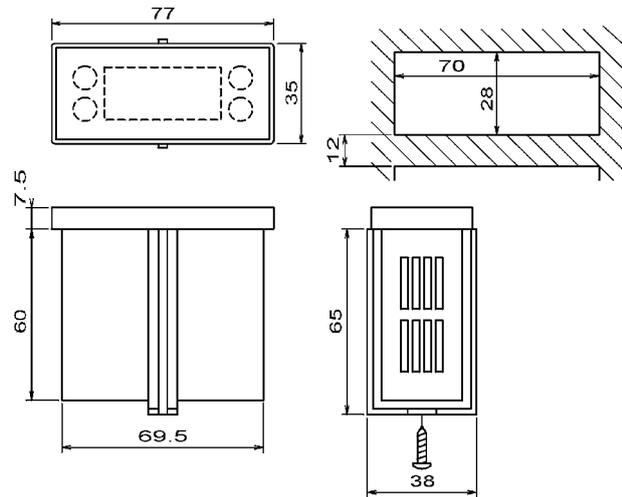


* **Connection diagram.**

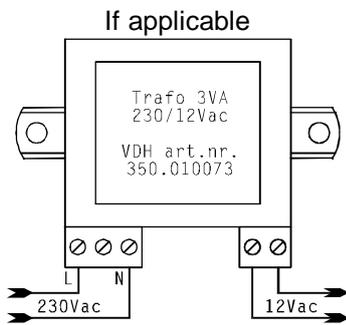


**ALFA(Net)
3X-series**

*)REMARK: To terminate RS485-Network
Connect a 250 Ohm resistor between
Line-A and Line-B at both cable-ends

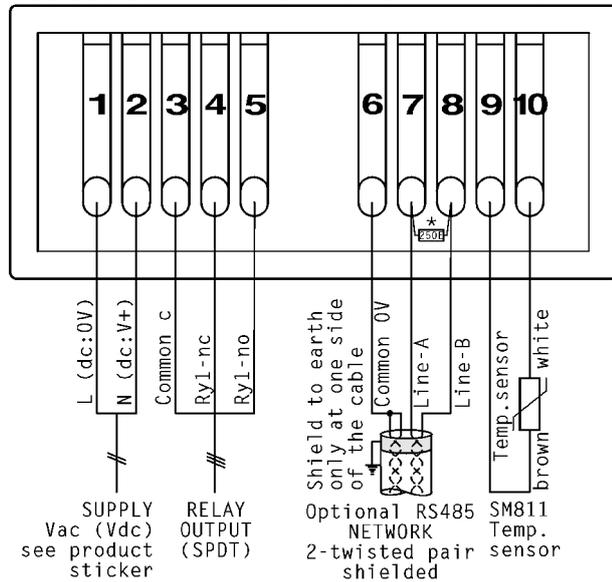

RS 485 NETWORK CONNECTIONS 2-twisted pair shielded cable:

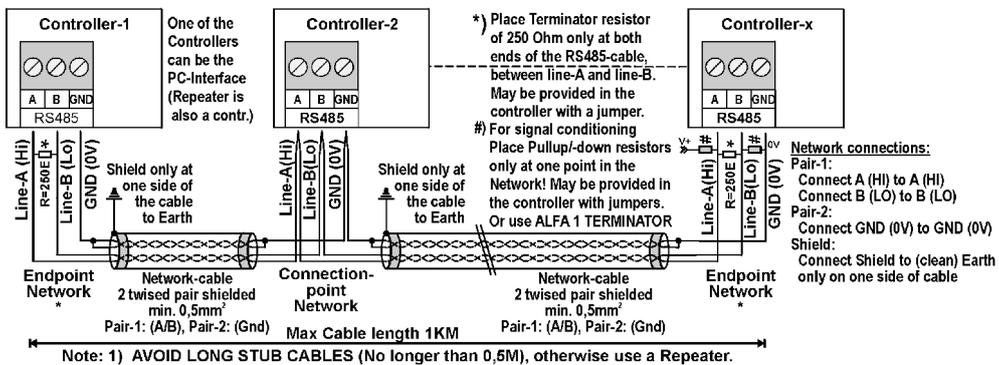

* **Address.**

VDH Products BV
Produktieweg 1
9301 ZS Roden
The Netherlands

Tel: +31 (0)50 - 30 28 900
Fax: +31 (0)50 - 30 28 980
Email: info@vdhproducts.nl
Internet: www.vdhproducts.nl